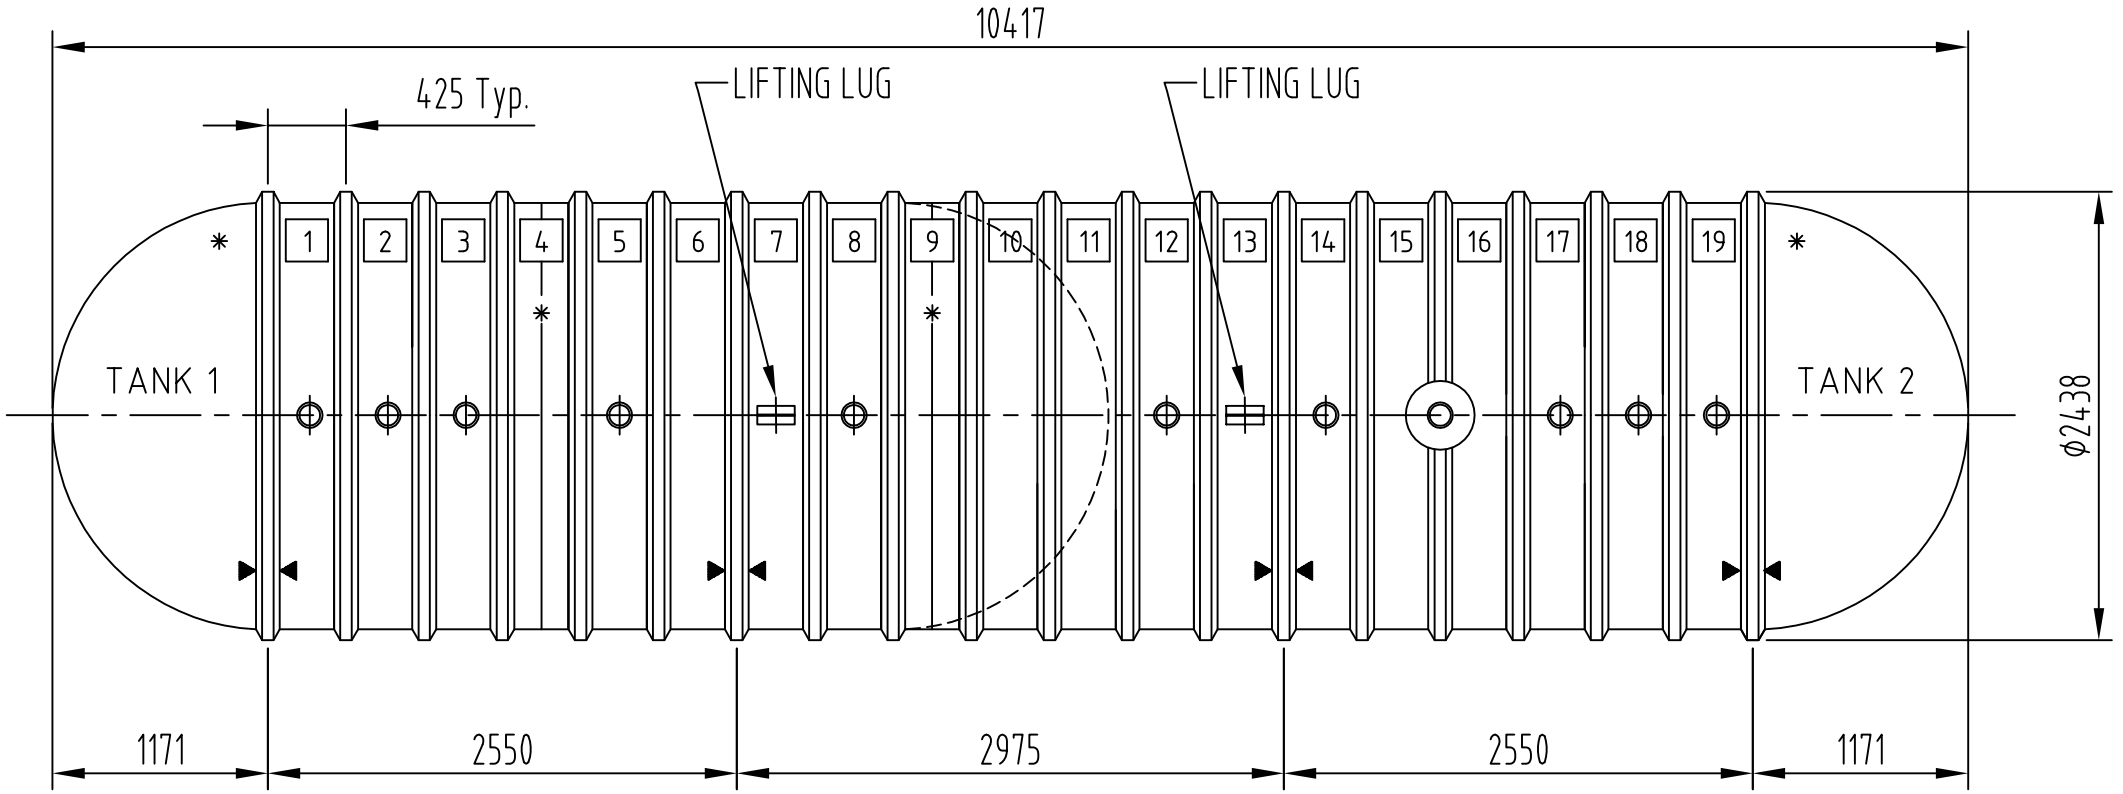

FITTING SCHEDULE

FLAT No.	SIZE	ITEM	DESCRIPTION
19	100NB	SOCKET	100NB BSP SOCKET
18	100NB	SOCKET	100NB BSP SOCKET
17	100NB	SOCKET	100NB BSP SOCKET
15-16	100NB	MONITOR	INTERSTICE MONITOR SOCKET
12-14	100NB	SOCKET	100NB BSP SOCKET
8	100NB	SOCKET	100NB BSP SOCKET
5	100NB	SOCKET	100NB BSP SOCKET
3	100NB	SOCKET	100NB BSP SOCKET
2	100NB	SOCKET	100NB BSP SOCKET
1	100NB	SOCKET	100NB BSP SOCKET

FIBRETANK SYSTEMS Pty Limited

Notes
- Tie-Down Straps to suit this tank are part no.
- Deadmen to suit this tank are part no.
- UNO, all sockets are BSP and are c/w striker plates under.

No	Revision Details	By	Date
A	Original Issue	–	–

DRAWN: V.B.B.

DATE: 24-07-01

App. Weight: 2,100 kg

App. Capacity: 40,472 L

Construction	Type	Compartment Configuration
DOUBLE WALL	TYPE 40	DOUBLE 20/20

DRAWING NUMBER: FK 040000-000

REVISION: A

The contractor shall provide Fibreglass Reinforced Plastic (FRP) underground storage tanks as illustrated. Sizes & fittings shall be as noted. The tanks shall be "Century-Cast" tanks as manufactured by Fibretank Systems Tanks shall be tested & installed as per current specifications and instructions.

All dimensions in millimetres. All dimensions are nominal unless a manufacturing tolerance has been specified.

THIS DRAWING & THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FIBRE TANK SYSTEMS AND STRICTLY CONFIDENTIAL & MUST NOT BE USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF FIBRETANK SYSTEMS PTY LIMITED

FIBRETANK SYSTEMS Pty Limited
PO BOX 102
CARRINGTON., NSW 2294
Ph:(02)4961-2745 Fax:(02)4962-2812