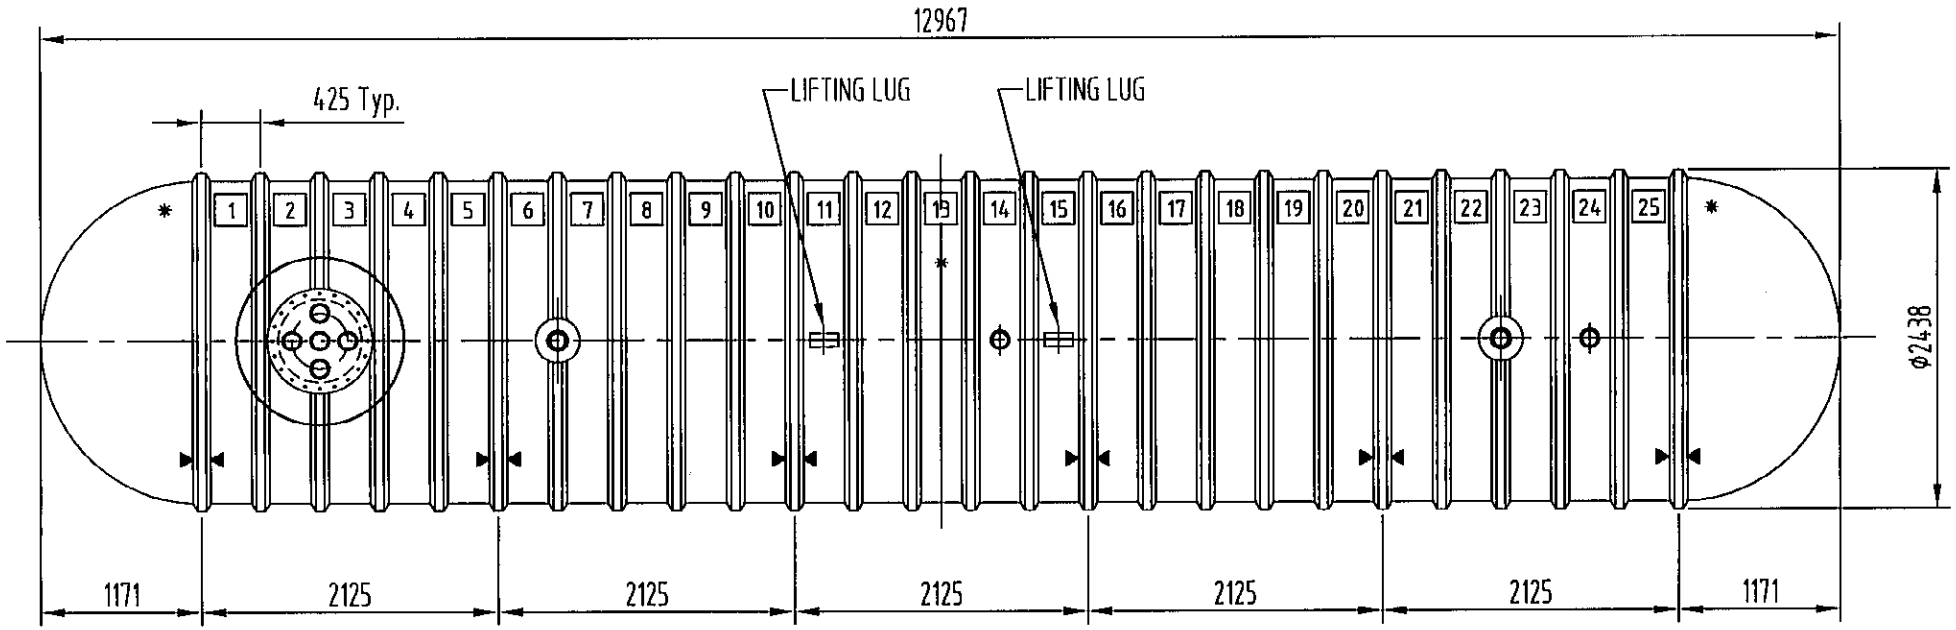

▶◀ HOLD DOWN STRAP LOCATION * FITTINGS CANNOT BE INSTALLED IN THESE LOCATIONS

FITTING SCHEDULE

FLAT No.	SIZE	ITEM	DESCRIPTION
24	100NB	SOCKET	100NB BSP SOCKET
22-23	100NB	MONITOR	INTERSTICE MONITOR SOCKET
14	100NB	SOCKET	100NB BSP SOCKET
6-7	100NB	MONITOR	INTERSTICE MONITOR SOCKET
2-3	600NB	MANHOLE	MANHOLE c/w COVER & 5 x 100NB SOCKETS, RISER & LID

Notes
- Tie-Down Straps to suit this tank are STP part no.
- Deadmen to suit this tank are STP part no.
- UNO, all sockets are BSP and are c/w striker plates under.

No	Revision Details	By	Date
A	Original Issue	–	–

FIBRETANK SYSTEMS Pty Limited

DRAWN: V.B.B.
DATE: 17-07-01
App. Weight: 2,450 kg
App. Capacity: 51,200 L

Construction	Type	Compartment Configuration
DOUBLE WALL	TYPE 50	SINGLE

DRAWING NUMBER: FD 050000-000
REVISION: A

The contractor shall provide Fibreglass Reinforced Plastic (FRP) underground storage tanks as illustrated. Sizes & fittings shall be as noted. The tanks shall be "Century-Cast" tanks as manufactured by Fibretank Systems Tanks shall be tested & installed as per current specifications and instructions.

All dimensions in millimetres. All dimensions are nominal unless a manufacturing tolerance has been specified.

THIS DRAWING & THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FIBRE TANK SYSTEMS AND STRICTLY CONFIDENTIAL & MUST NOT BE USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF STP GROUP PTY LTD

FIBRETANK SYSTEMS Pty Limited
PO BOX 102
CARRINGTON., NSW 2294
Ph:(02)4961-2745 Fax:(02)4962-2812