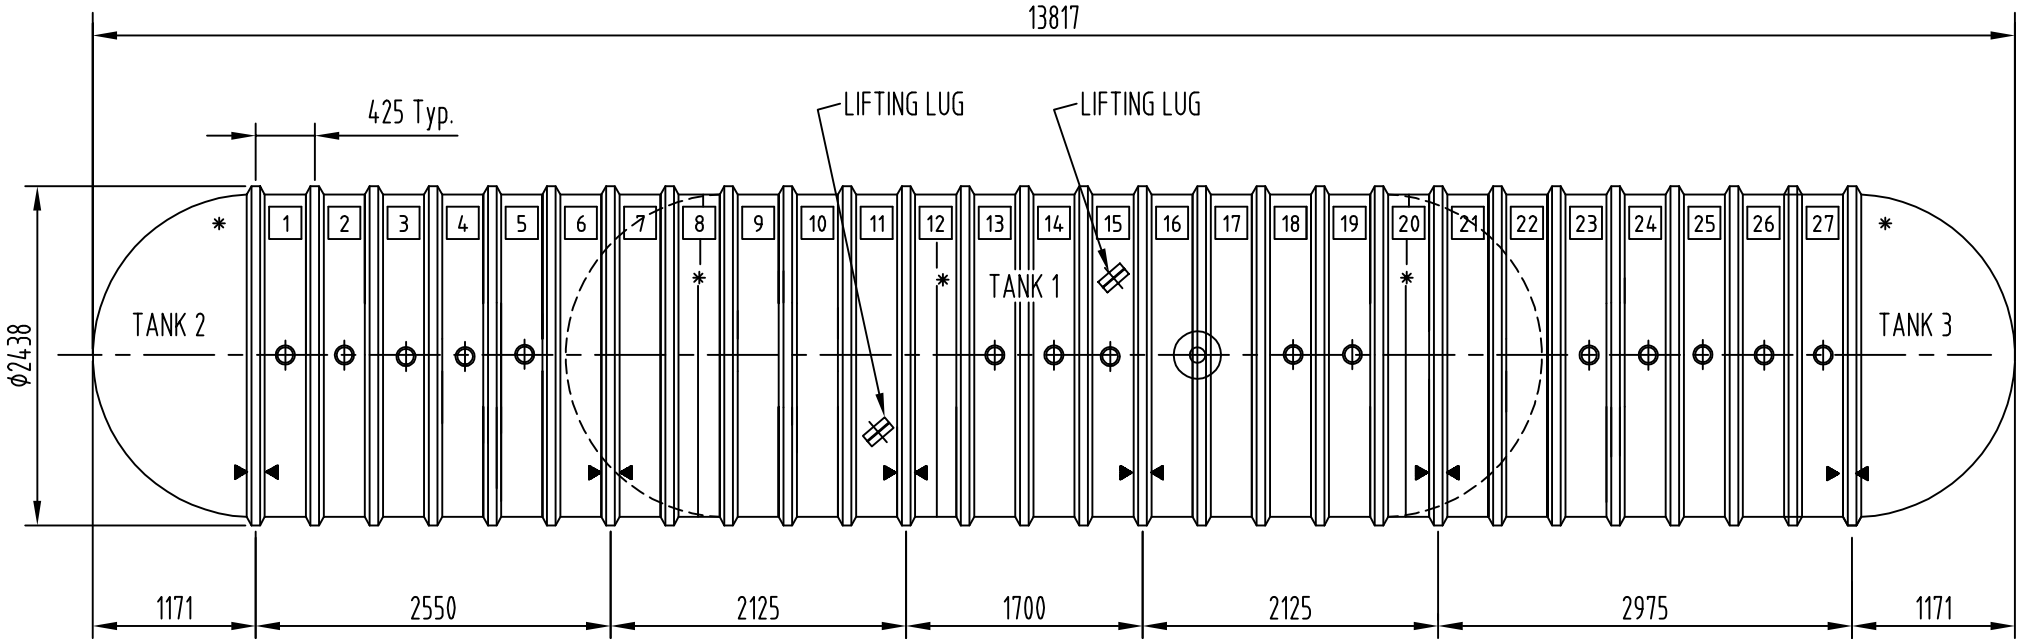

TANK 2 VOLUME = 14,358 L

TANK 1 VOLUME = 26,179 L

TANK 3 VOLUME = 14,358 L

▶◀ HOLD DOWN STRAP LOCATION

* FITTINGS CANNOT BE INSTALLED IN THESE LOCATIONS

FITTING SCHEDULE

FLAT No.	SIZE	ITEM	DESCRIPTION
23-27	100NB	SOCKET	100NB BSP SOCKET
18-19	100NB	SOCKET	100NB BSP SOCKET
16-17	100NB	MONITOR	INTERSTICE MONITOR SOCKET
13-15	100NB	SOCKET	100NB BSP SOCKET
1-5	100NB	SOCKET	100NB BSP SOCKET

FTS STANDARD

Notes

- Tie-Down Straps to suit this tank are part no.
- Deadmen to suit this tank are part no.
- UNO, all sockets are BSP and are c/w striker plates under.

No	Revision Details	By	Date
A	Original Issue	–	–

DRAWN: KJM

DATE: 16.10.07

App. Weight: 3,700kg

App. Capacity: 53,188 L

Construction: DOUBLE WALL

Type: TYPE 55

Compartment Configuration: TRIPLE 15/25/15

DRAWING NUMBER: FQ 055000-001

REVISION: A

The contractor shall provide Fibreglass Reinforced Plastic (FRP) underground storage tanks as illustrated. Sizes & fittings shall be as noted. The tanks shall be "Century-Cast" tanks as manufactured by Fibretank Systems Tanks shall be tested & installed as per current specifications and instructions.

All dimensions in millimetres. All dimensions are nominal unless a manufacturing tolerance has been specified.

THIS DRAWING & THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FIBRE TANK SYSTEMS AND STRICTLY CONFIDENTIAL & MUST NOT BE USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF FIBRETANK SYSTEMS PTY LIMITED

FIBRETANK SYSTEMS Pty Limited
PO BOX 102
CARRINGTON., NSW 2294
Ph:(02)4961-2745 Fax:(02)4962-2812