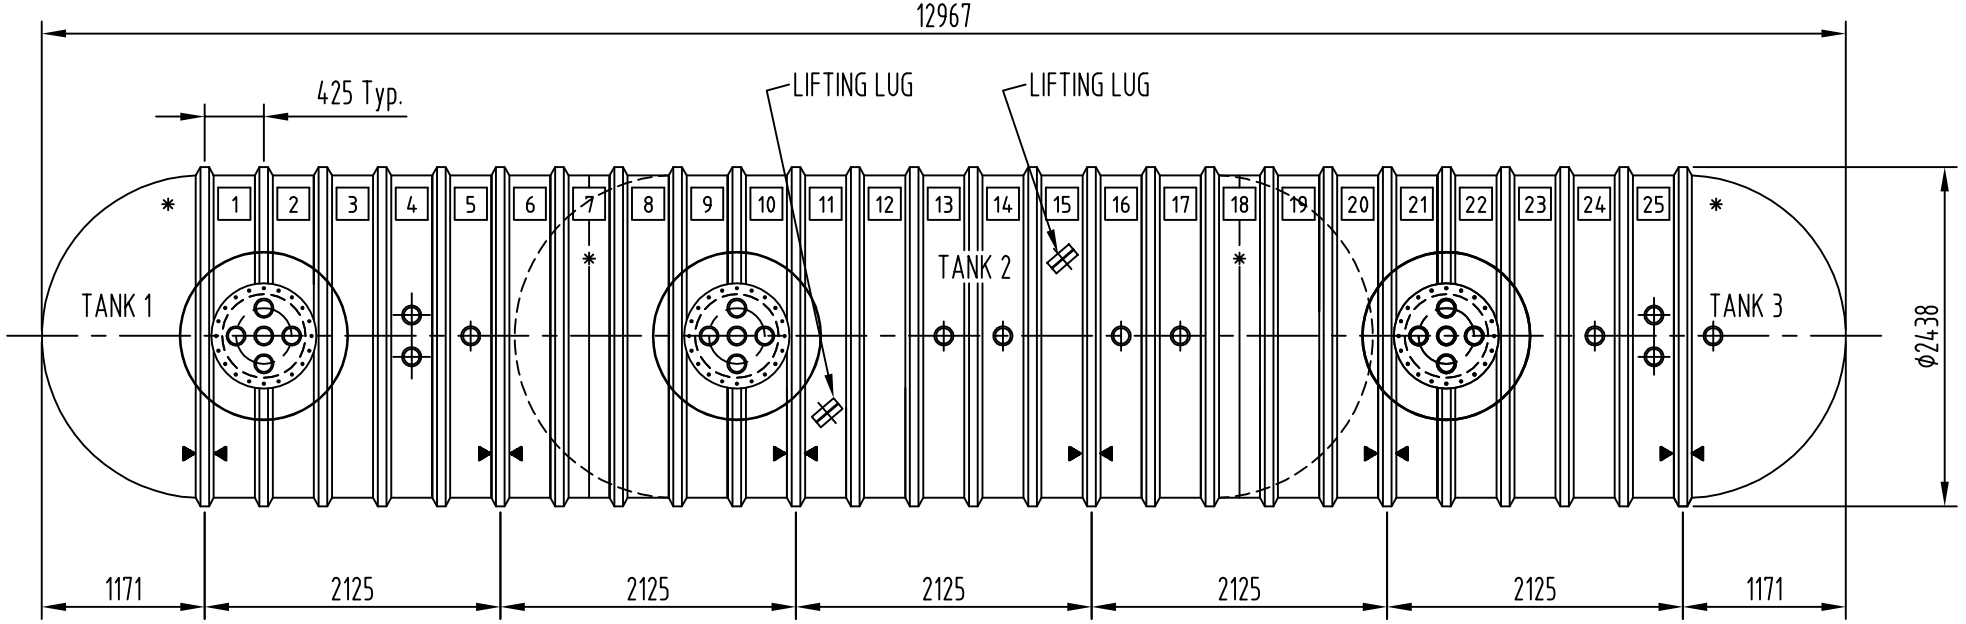

TANK 1 VOLUME = 14,304 L

TANK 2 VOLUME = 22,592 L

TANK 3 VOLUME = 14,304 L

▶◀ HOLD DOWN STRAP LOCATION

✱ FITTINGS CANNOT BE INSTALLED IN THESE LOCATIONS

FITTING SCHEDULE

FLAT No.	SIZE	ITEM	DESCRIPTION
DOME	100NB	SOCKET	100NB BSP SOCKET
25	100NB	DUPLEX	2 x 100NB BSP SOCKET
24	100NB	SOCKET	100NB BSP SOCKET
21-22	600NB	MANHOLE	MANHOLE c/w COVER & 5 x 100NB SOCKETS, RISER & LID
16-17	100NB	SOCKET	100NB BSP SOCKET
13-14	100NB	SOCKET	100NB BSP SOCKET
9-10	600NB	MANHOLE	MANHOLE c/w COVER & 5 x 100NB SOCKETS, RISER & LID
5	100NB	SOCKET	100NB BSP SOCKET
4	100NB	DUPLEX	2 x 100NB BSP SOCKET
1-2	600NB	MANHOLE	MANHOLE c/w COVER & 5 x 100NB SOCKETS, RISER & LID

UNITED PETROLEUM Pty Ltd

Notes

- Tie-Down Straps to suit this tank are part no.
- Deadmen to suit this tank are part no.
- UNO, all sockets are BSP and are c/w striker plates under.

No	Revision Details	By	Date
A	Original Issue	–	–

DRAWN: V.B.B.

DATE: 11-12-01

App. Weight: 1,850kg

App. Capacity: 51,200 L

Construction	Type	Compartment Configuration
SINGLE WALL	TYPE 50	TRIPLE 15/20/15

DRAWING NUMBER: FL 050000-001

REVISION: A

The contractor shall provide Fibreglass Reinforced Plastic (FRP) underground storage tanks as illustrated. Sizes & fittings shall be as noted. The tanks shall be "Century-Cast" tanks as manufactured by Fibretank Systems Tanks shall be tested & installed as per current specifications and instructions.

All dimensions in millimetres. All dimensions are nominal unless a manufacturing tolerance has been specified.

THIS DRAWING & THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FIBRE TANK SYSTEMS AND STRICTLY CONFIDENTIAL & MUST NOT BE USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF FIBRETANK SYSTEMS PTY LIMITED

FIBRETANK SYSTEMS Pty Limited
PO BOX 102
CARRINGTON., NSW 2294
Ph:(02)4961-2745 Fax:(02)4962-2812