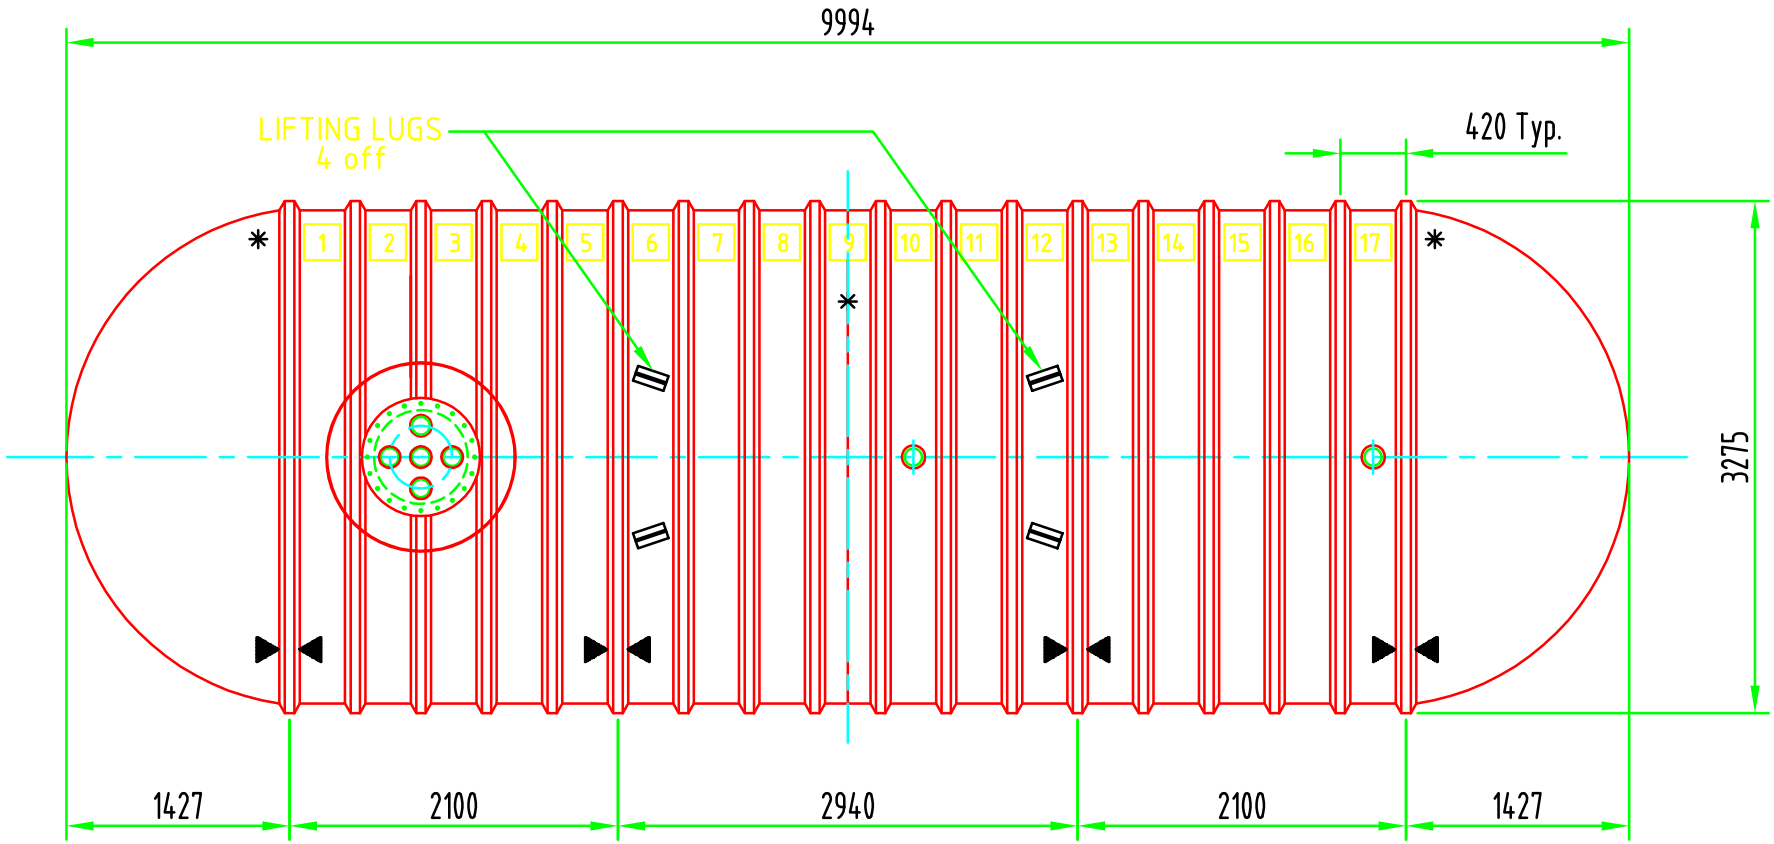

HOLD DOWN STRAP LOCATION

FITTINGS CANNOT BE INSTALLED IN THESE LOCATIONS

FITTING SCHEDULE

FIBRETANK SYSTEMS Pty Limited

FLAT No.	SIZE	ITEM	DESCRIPTION	Notes
17	100NB	SOCKET	100NB BSP SOCKET	– Tie-Down Straps to suit this tank are part no.
10	100NB	SOCKET	100NB BSP SOCKET	– Deadmen to suit this tank are part no.
2-3	600NB	MANHOLE	MANHOLE c/w COVER & 5 x 100NB SOCKETS, RISER & LID	– UNO, all sockets are BSP and are c/w striker plates under.

No	Revision Details	By	Date
A	Original Issue	–	–

DRAWN: V.B.B.

DATE: 1-06-01

App. Weight: 2,062 KG

App. Capacity: 72,005 L

Construction	Type	Compartment Configuration
SINGLE WALL	TYPE 70	SINGLE

DRAWING NUMBER: FP 070000-000

REVISION: A

The contractor shall provide Fibreglass Reinforced Plastic (FRP) underground storage tanks as illustrated. Sizes & fittings shall be as noted. The tanks shall be "Century-Cast" tanks as manufactured by Fibretank Systems Tanks shall be tested & installed as per current specifications and instructions.

All dimensions in millimetres. All dimensions are nominal unless a manufacturing tolerance has been specified.

THIS DRAWING & THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FIBRE TANK SYSTEMS AND STRICTLY CONFIDENTIAL & MUST NOT BE USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF FIBRETANK SYSTEMS PTY LIMITED

FIBRETANK SYSTEMS Pty Limited
PO BOX 102
CARRINGTON., NSW 2294
Ph:(02)4961-2745 Fax:(02)4962-2812