



12770 OVERALL (APPROX)

12000 SHELL

4000 CTRS

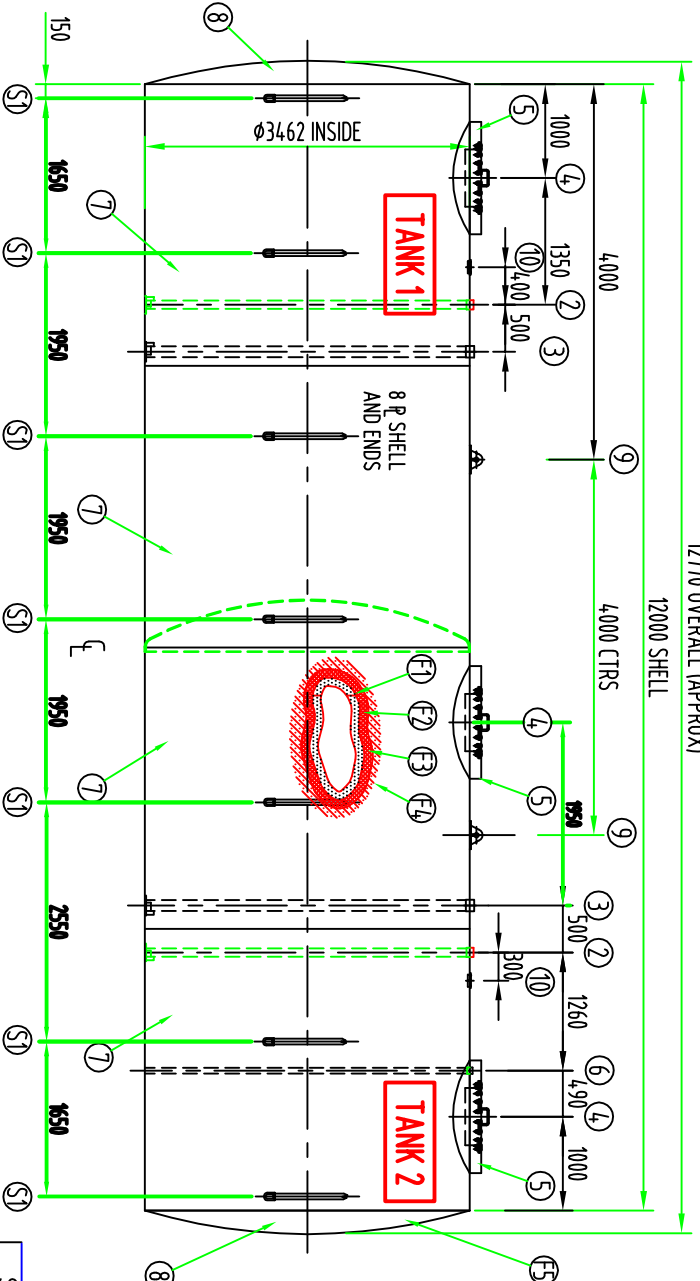

ITEM	DESCRIPTION	WEIGHT
F5	RUST RED FLOWCOAT	-
F4	GLASS OWENN'S CORNINS 360 RR	-
F3	CATALYST	-
F2	AROPOL 7241 PS/PW	-
F1	STAND OFF MATERIAL	-

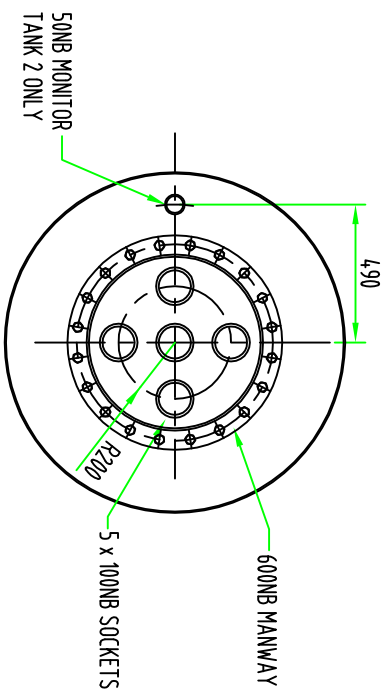

PLAN VIEW ON MANWAY

**TANK 1 VOLUME - 56,500 L APPROX**

**TANK 2 VOLUME - 59,500 L APPROX**

- NOTE:
- VACUUM ON INTERSTITIAL SPACE IS FACTORY SET & GAUGE SET
  - INSTALLATION AS PER GLASTEEL II INSTALLATION INSTRUCTIONS & APPLICABLE CODES
  - VESSEL IDENTIFICATION No. & MANUFACTURE DATE ARE LAMINATED TO TOP OF VESSEL
  - VESSEL MANUFACTURED TO AS1692
  - PLASTIC LIFTING LUG COVERS SUPPLIED WITH VESSEL
  - HOLD DOWN STRAPS POSITION ARE TO BE MARKED ON VESSEL DURING MANUFACTURING
  - ALL SOCKETS TO BE CLEANED AND FITTED WITH PLASTIC DUST CAPS
  - 8:6mm STRIKER PLATES TO BE FITTED UNDER ALL OPENINGS
  - ALL WELDS AS PER AS1554.1-GP (N.D.T. - VISUAL)
  - VOLUME = 116,000 L (APPROX)
  - WEIGHT OF TANK = 10,535 kg (APPROX)

No.	REVISION DETAILS	BY	DATE	CLIENT:
F				DRAWN: KJM
E				CHECKED:
D				APPROVED:
C	2nd MANHOLE ADDED TO TANK 2	TAH	11-05-06	ORDER No:
B	NOZ No 1 DELETED * HOLD DOWNS REPOSITIONED	TAH	04-05-06	SCALE: N.T.S.
A	ORIGINAL ISSUE	KJM	Nov.05	CAD REF: JG-GST-SC-P

ITEM	QTY	DESCRIPTION	PART / SUB ASSM No.
10	2	100NB BSP SOCKETS	
9	2	LIFTING LUG - 7.5 TONNE C/W DOUBLER PAD	SUB10777
8	3	END SLIP IN 3462 ID x 8 PLATE	SUB1017
7	4	SHELL 3462 ID x 8 PLATE x 3000 LONG	SUB1041
6	1	50NB MONITOR SOCKET C/W INTERNAL PIPE	SUB1082
5	3	FRP COLLAR	SUB1028
4	3	600NB MANWAY C/W 5 X 100NB SOCKETS	SUB1095
3	2	100NB FILL SOCKET C/W PIPE	SUB1058
2	2	100NB DIP SOCKET C/W PIPE	SUB1053

TITLE: GENERAL ARRANGEMENT T110 (SPLIT 55/55)  
GLASTEEL II U/G STORAGE VESSEL (8mm SHELL)

ESTIMATE NUMBER: N/A

DRAWING NUMBER: JG 110000-002

JOB No: SHEET: 1 of 1 REVISION: C

VESEL CLASS N/A

SHEET SIZE A3

FIBRETEK SYSTEMS  
PTY LIMITED

PO BOX 102  
CARINGTON N.S.W. 2294  
PHONE (02) 4961-2745  
FAX (02) 4962-2812

THIS DRAWING & THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FIBRETEK SYSTEMS AND IS STRICTLY CONFIDENTIAL & MUST NOT BE USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF FIBRETEK SYSTEMS Pty LIMITED

Dimension in millimetres and/or client requirement.

All tolerancing to be to the applicable design code of manufacture,