


7550 OVERALL (APPROX)

7200 SHELL

2400 CTRS

2400

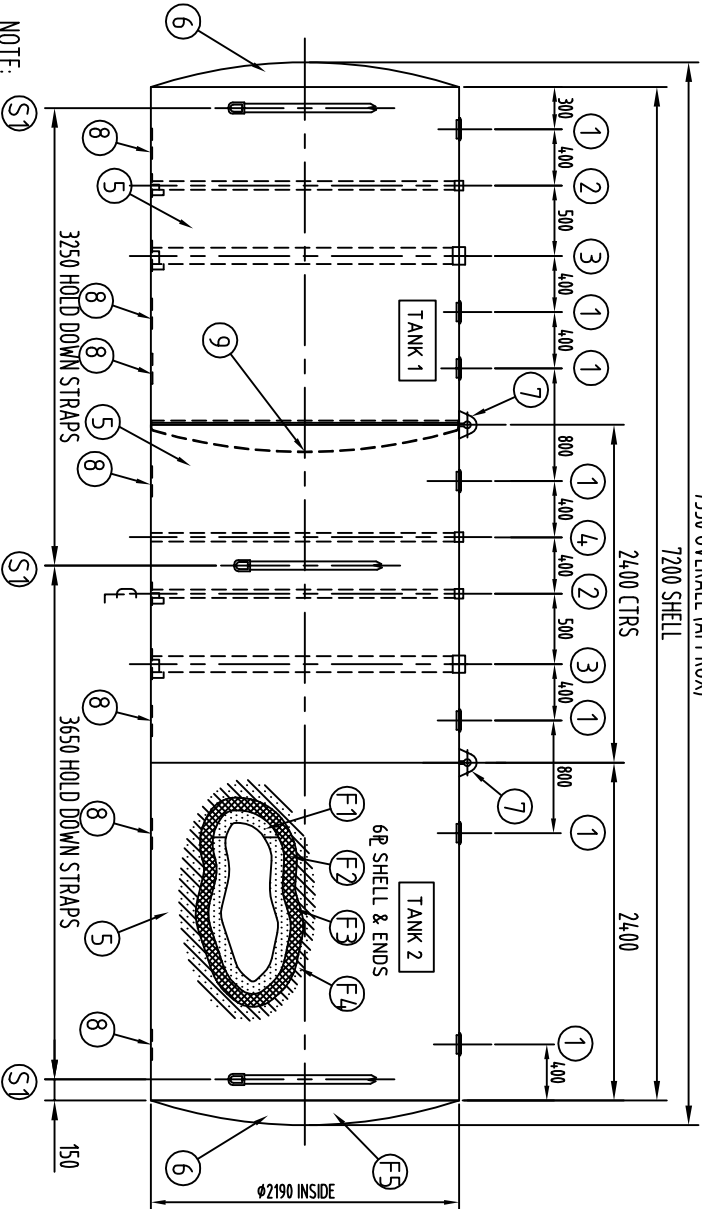

NOTE:

- 1: VACUUM ON INTERSTITIAL SPACE IS FACTORY SET & GAUGE SET
- 2: INSTALLATION AS PER GLASTEEL II INSTALLATION INSTRUCTIONS & APPLICABLE CODES
- 3: VESSEL IDENTIFICATION NO. & MANUFACTURE DATE ARE LAMINATED TO TOP OF VESSEL
- 4: VESSEL MANUFACTURED TO AS1692
- 5: PLASTIC LIFTING LUG COVERS SUPPLIED WITH VESSEL
- 6: HOLD DOWN STRAPS POSITION ARE TO BE MARKED ON VESSEL DURING MANUFACTURING
- 7: ALL SOCKETS TO BE CLEANED AND FITTED WITH PLASTIC DUST CAPS
- 8: 6mm STRIKER PLATES TO BE FITTED UNDER ALL OPENINGS
- 9: ALL WELDS AS PER AS1554.1-GP (ND.T. - VISUAL)
- 10: VOLUME = 27,780 L (APPROX)
- 11: WEIGHT OF TANK = 2,805 kg (APPROX)

No.	REVISION DETAILS	BY	DATE	CLIENT:
F				FTS STD
E				DRAWN: V.B.B. DATE: 11-07-01
D				CHECKED: DATE:
C				APPROVED: DATE:
B	SCHEDULE AMENDED	ND	7.6.05	ORDER No: No OFF: ONE (1)
A	ORIGINAL ISSUE	0	0	SCALE: 1:30 CAD REF: JD-GST-DC-S

All tolerancing to be to the applicable design code of manufacture, and/or client requirement.		Dimension in millimetres
JOB No: SHEET: 1 of 1 REVISION: B		
ESTIMATE NUMBER: N/A DRAWING NUMBER: JD 025000-000		
TITLE: GENERAL ARRANGEMENT T25 SPLIT (15/10) GLASTEEL II U/G STORAGE VESSEL (6mm SHELL)		
VESEL CLASS N/A		SHEET SIZE A3

ITEM	DESCRIPTION	WEIGHT
F5	RUST RED FLOWCOAT	-
F4	GLASS OWENN'S CORNINS 360 RR	-
F3	CATALYST	-
F2	AROPOL 7241PS/PW	-
F1	TEXOPRINT MAT	-

FIBREGLASS

TANK 1 VOLUME = 9,780 L APPROX TANK 2 VOLUME = 18,000 L APPROX

S1	DESCRIPTION	QTY	PART / SUB ASSM No.
1	HOLD DOWN STRAPS	3	015001
2	VACUUM MONITOR GAUGE	1	003137, 017111, 017160
3	LIFTING LUG COVERS	2	015071
4	DIPSTICK 9,780 L	1	SPECIAL
5	DIPSTICK 18,000 L	1	SPECIAL
6	ACCESSORIES	QTY	PART / SUB ASSM No.

ITEM	QTY	DESCRIPTION	PART / SUB ASSM No.
1	1	END SLIP-IN 2190 x 6 PLATE	SUB1013
2	7	STRIKER PLATE	SUB1047
3	2	LIFTING LUG - 2 TONNE	SUB1075
4	2	END D & F 2190 ID x 6 PLATE	SUB1004
5	3	SHELL 2190 ID x 6 PLATE x 2400 LONG	SUB1038
6	1	50NB MONITOR SOCKET C/W INTERNAL PIPE	SUB1081
7	2	100NB FILL SOCKET C/W PIPE	SUB1056
8	2	50NB DIP SOCKET C/W PIPE	SUB1050
9	7	100NB PHOENIX FLANGE	006395

FTS STD
DATE: 11-07-01
DRAWN: V.B.B.
CHECKED: DATE:
APPROVED: DATE:
ORDER No: No OFF: ONE (1)
SCALE: 1:30
CAD REF: JD-GST-DC-S

PO BOX 102
CARRINGTON N.S.W. 2294
PHONE (02) 4961-2745
FAX (02) 4962-2812

THIS DRAWING & THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FIBRETANK SYSTEMS AND IS STRICTLY CONFIDENTIAL & MUST NOT BE USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF FIBRETANK SYSTEMS Pty LIMITED