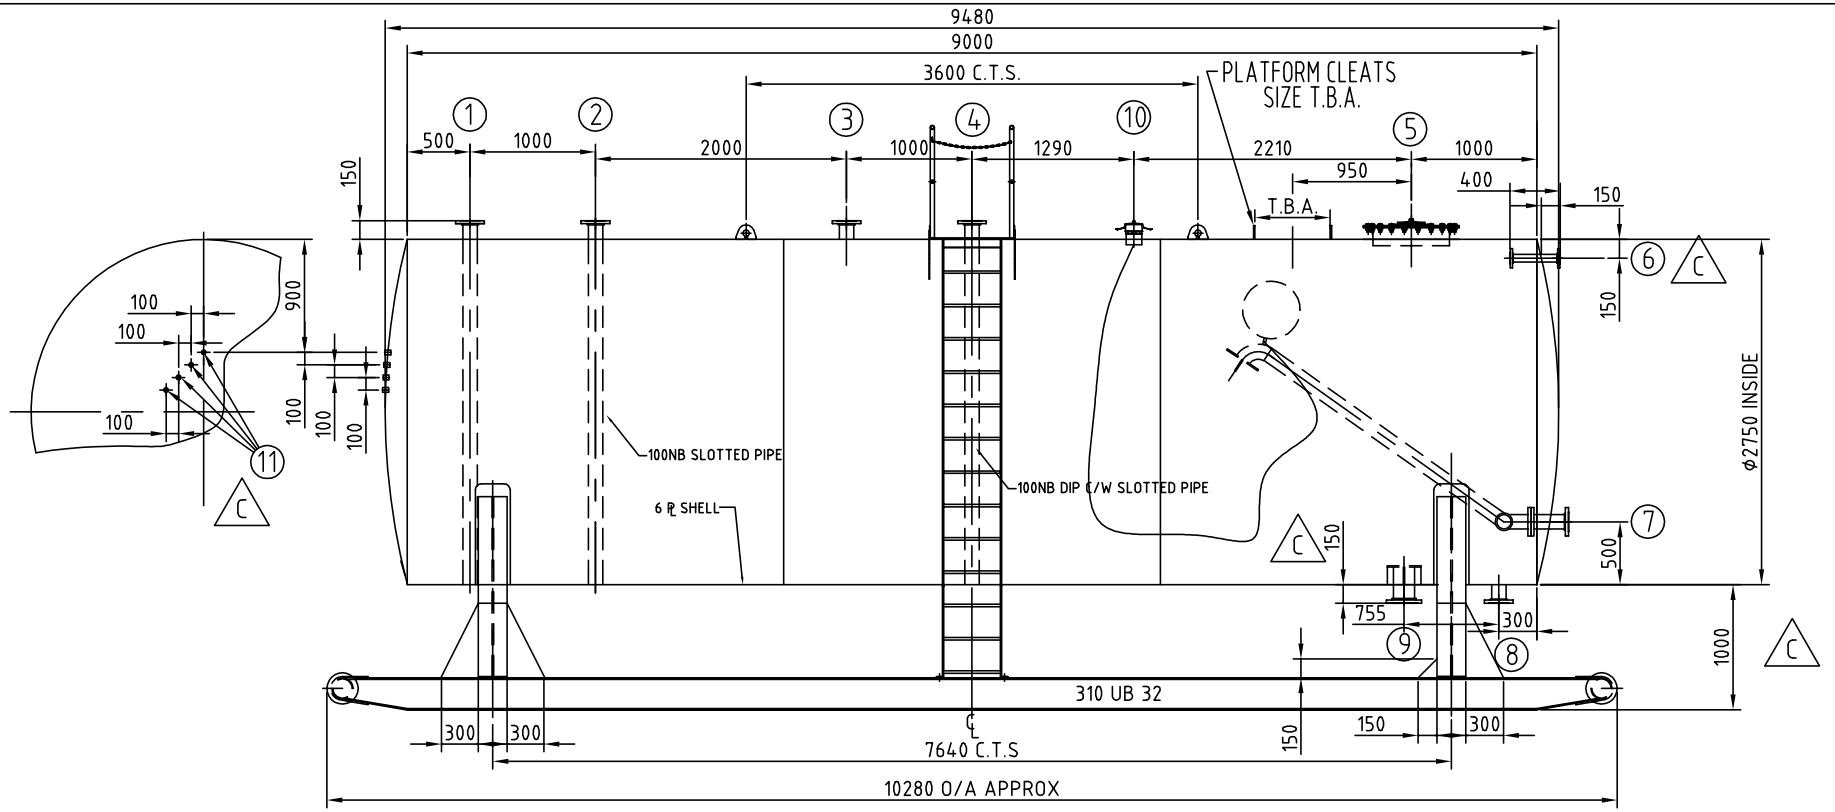

ITEM	QTY	DESCRIPTION
11	4	15NB NPT COUPLING FOR TRICOCKS
10	1	FLOATING SUCTION JIGGER WIRE (100NB KAMLOCK & CAP)
9	1	150NB 150# ANSI S.O/R.F FLANGE C/W INTERNAL VORTEX BREAKER
8	1	100NB 150# ANSI S.O/R.F FLANGE
7	1	100NB 150# ANSI S.O/R.F FLANGE C/W AL FLOATING SUCTION
6	2	50NB 150# ANSI S.O/R.F FLANGE
5	1	600NB MANWAY C/W EMERGENCY VENT
4	1	100NB 150# ANSI S.O/R.F FLANGE DIP HATCH C/W INTERNAL PIPE
3	1	100NB 150# ANSI S.O/R.F FLANGE VENT
2	1	100NB 150# ANSI S.O/R.F FLANGE C/W PERFERATED INTERNAL PIPE
1	1	100NB 150# ANSI S.O/R.F FLANGE C/W INTERNAL PIPE

NOTE:
1: VESSEL IS MANUFACTURED TO AS1692 AND AIR TESTED TO 35kPa
2: VESSEL MATERIAL TO AS3678 GRADE 250
3: VESSEL WELDED TO AS1554 PART 1-GP
4: VESSEL SURFACE FINISH - ABRASIVE BAST TO AS1627-4 CLASS 2.5
- PAINTING TO SANTOS SPECIFICATIONS
5: APPROX WEIGHT OF VESSEL = 4,900kg
6: APPROX WEIGHT OF SKID & VESSEL = 5,700kg

No.	REVISION DETAILS	BY	DATE
F			
E			
D			
C	UPDATE AS PER FAX DATED 6/11/01	V.B.B.	7-11-01
B	APPROVED FOR MANUFACTURE ITEM 9 WAS 100NB	V.B.B.	13-09-01
A	ORIGINAL ISSUE	0	0

CLIENT:

DRAWN: V.B.B.	DATE: 6-9-01
CHECKED:	DATE:
APPROVED:	DATE:
ORDER No:	No OFF: ONE (1)
SCALE: N.T.S.	CAD REF: STEEL-TKS

Dimension in millimetres
All tolerancing to be to the applicable design code of manufacture, and/or client requirement.

FIBRETANK SYSTEMS PTY LIMITED
PO BOX 102
CARRINGTON N.S.W. 2294
PHONE (02) 4961-2745
FAX: (02) 4962-2812

THIS DRAWING & THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF FIBRETANK SYSTEMS AND IS STRICTLY CONFIDENTIAL & MUST NOT BE USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF FIBRETANK SYSTEMS Pty LIMITED

TITLE:
GENERAL ARRANGEMENT
T55 O/G STORAGE VESSEL ON SKID

VESSEL CLASS: N/A

ESTIMATE NUMBER: N/A

DRAWING NUMBER: SA 055000-001

SANTOS DWG.No 9001-TK-014

SHEET SIZE: A3

JOB No:

SHEET: 1 of 1

REVISION: C